




Product Owner's Manual
Manual del propietario del producto
Manuel du propriétaire du produit

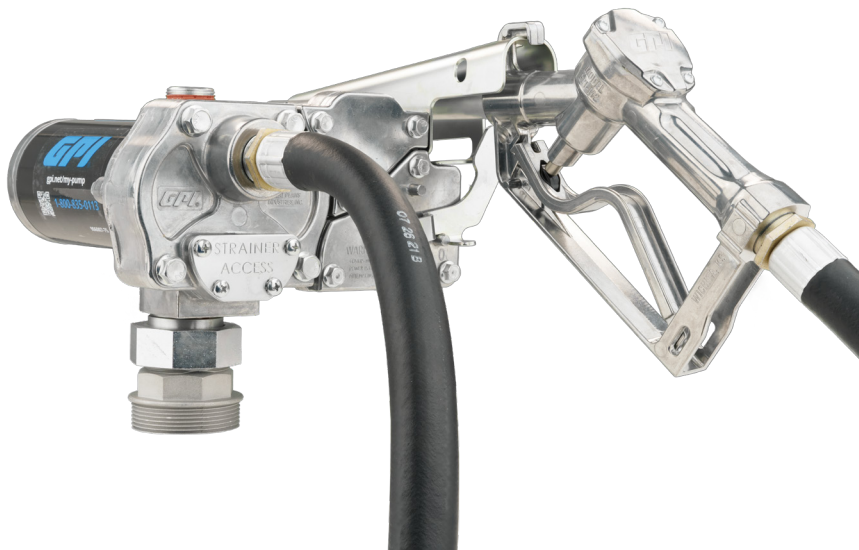

M-1115S Methanol

120V (AC)

Methanol Fuel Transfer Pump

Bomba de Transferencia de Combustible de Metanol

Pompe de Transfert de Carburant au Méthanol

Models: M-1115S-Methanol

Thank you for choosing Great Plains Industries as your preferred brand! Our team places innovation, precision, and care into every product made, providing you with the best total value. This manual contains critical product information.

Save these instructions and observe all safety information to prevent personal injury or property damage. See back cover for warranty and customer support details.

DO NOT RETURN THIS PRODUCT TO THE STORE!

Please contact Great Plains Industries, Inc. before returning any product. If you are missing parts, or experience problems with your installation, contact our Customer Support Department. We will be happy to assist you.

EN

¡Gracias por elegir Great Plains Industries como su marca preferida! Nuestro equipo pone innovación, precisión y cuidado en cada producto fabricado, proporcionándole el mejor valor total. Este manual contiene información crítica del producto. Guarde estas instrucciones y observe toda la información de seguridad para evitar lesiones personales o daños materiales. Consulte la contraportada para obtener detalles sobre la garantía y el soporte al cliente.

¡NO DEVUELVA ESTE PRODUCTO A LA TIENDA!

Comuníquese con Great Plains Industries, Inc. antes de devolver cualquier producto. Si le faltan piezas o experimenta problemas con su instalación, comuníquese con nuestro Departamento de atención al cliente. Estaremos encantados de ayudarle.

ES

Merci d'avoir choisi Great Plains Industries comme votre marque préférée! Notre équipe place l'innovation, la précision et le soin dans chaque produit fabriqué, vous offrant la meilleure valeur totale. Ce manuel contient des informations critiques sur le produit. Conservez ces instructions et respectez toutes les informations de sécurité pour éviter les blessures corporelles ou les dommages matériels. Consultez la couverture arrière pour obtenir des détails sur la garantie et le support client.

NE PAS RENVoyer CE PRODUIT AU MAGASIN !

Veuillez contacter Great Plains Industries, Inc. avant de retourner un produit. S'il vous manque des pièces ou si vous rencontrez des problèmes avec votre installation, contactez notre service d'assistance à la clientèle. Nous serons heureux de vous aider.

FR

Call / Llamar / Appel: 800-835-0113 or 316-686-7361

Email: gpi-sales@gplains.com

Website: gpi.net

SAVE / GUARDAR / CONSERVEZ

Model / Modelo / Modèle #: _____

Serial / Serie / Série #: _____

Date / Fecha / Date: _____

BEFORE YOU BEGIN

Fuel Compatability Statement

- This fuel pump is designed, tested and approved for use with methanol. Please take all due precautions when handling these flammable liquids.
- Do not use this pump for dispensing any fluids other than those for which it was designed. To do so may damage the pumps components and will void the warranty.

Power Source Requirements:



- This manual covers 115-volt AC electric gear pump models M-1115S Methanol.
- Models M-1115S Methanol should be connected to a 115-volt AC power source only.
- Do not attempt connection of any pump to a 12-volt DC, 24-volt DC or 230-volt AC power source.

Tools Needed:

- Adjustable Wrench, Pipe Wrench, Pliers, Utility Knife, Wire Crimper/Stripper and Thread Tape

UNPACKING

Shipping Damage Check



- After unpacking the unit, inspect carefully for any damage that may have occurred during transit. Check for loose, missing or damaged parts. Shipping damage claims must be filed with carrier. Review General Safety Instructions and all Caution, Warning, and Danger statements as shown.

Contents:



- (1) 115-volt AC Methanol Transfer Pump with Spin Collar,
- (1) Fiber Gasket and (1) Tank Adapter (all models)
- (1) Lockable Nozzle Holder (all models)
- (3) Plastic Wire Nuts (all models)

GENERAL SAFETY INSTRUCTIONS

IMPORTANT: It is your responsibility to:

- Know and follow applicable national, state and local safety codes pertaining to installing and operating electrical equipment for use with flammable liquids.
- Know and follow all safety precautions when handling petroleum fuels.
- Ensure that all equipment operators have access to adequate instructions concerning safe operating and maintenance procedures.

Observe all safety precautions concerning safe handling of petroleum fuels

SYMBOLS



Description of imminent hazard and failure to avoid hazard will result in death.



Description of hazard and possible resulting injuries or death.



Description of hazard and possible resulting injuries.



This symbol indicates a general warning to the user. See additional specific warnings.



This symbol indicates electrical shock hazard. Follow proper installation and maintenance instructions in this manual.



This symbol indicates hot surface. Take care to avoid coming into contact with hot surface.



This symbol indicates automatic restart. Pump contains thermal protection which automatically shuts off motor before overheating. Pump will turn back on automatically after cooling. Turn switch OFF and wait 30 minutes to resume normal pumping. Disconnect power before any inspection or service.



Owner's manual must be read before using, inspecting, or servicing this product.



Disconnect power when product is unattended or in the case of a malfunction. Disconnect power before any inspection, servicing, or maintenance.



To prevent physical injury or property damage, observe precautions against fire or explosion when dispensing fuel. Do not operate the system in the presence of ignition sources such as, but not limited to: open flames, lighted cigarettes, running or hot engines, gas or electric heaters.



GENERAL SAFETY INSTRUCTIONS (CONTINUED)

SAFETY WARNINGS

⚠ DANGER

To prevent physical injury or property damage, observe precautions against fire or explosion when dispensing fuel. Do not operate the system in the presence of any source of ignition including running or hot engines, lighted tobacco products, gas or electric heaters, or any type of electronic device. A spark can ignite fuel vapors.

⚠ DANGER

Observe precautions against electrical shock when operating the system. Serious or fatal shock can result from operating electrical equipment in damp or wet locations.

⚠ DANGER

Observe precautions against electrical shock when servicing the pump. Always disconnect power before repairing or servicing. Never apply electrical power to the system when any of the cover plates are removed.

⚠ WARNING

To ensure safe operation, all fuel transfer systems must be properly grounded. Proper grounding means a continuous metal-to-metal contact from one component to the next, including tank, tank mount, pump, meter, filter, hose and nozzle. Care should be taken to ensure proper grounding during initial installation and after any service or repair procedures. For your safety, please take a moment to review the warnings below.

⚠ WARNING

Inspect external pump wiring regularly to make sure it is correctly connected. To avoid electrical shock, use extra care when connecting the pump to power.

⚠ WARNING

Avoid prolonged skin contact with petroleum fuels. Use protective goggles, gloves and aprons in case of splashing or spills. Change saturated clothing and wash skin promptly with soap and water.

⚠ WARNING

Securely fasten all wetted connections with the proper use of O-rings, or pipe sealant and thread tape. Leaking fuel may cause the potential for fire and explosion.

⚠ WARNING

Pump models that may be used in aviation refueling (PO/PX models) are NOT supplied with appropriate hose, nozzle, and suction pipe. These items must meet NFPA 407 guidelines.

For ground-based refueling only. Do not use in or on the aircraft. For use with aviation gasoline (AVGAS 100LL) and Jet A. User should consult NFPA 407 Standard for Aircraft Fuel Servicing for safety requirements during ground fuel servicing of aircraft using liquid petroleum fuels. This product has no actual or implied compliance with this standard.

⚠ WARNING

This pump is provided with an internal auxiliary temperature-limiting device which automatically shuts off the motor before overheating. The pump will turn back on automatically after cooling if the switch is not in the off position. Turn the switch OFF and wait 30 minutes to resume normal operation.

⚠ CAUTION

If using solvent to clean pump components or tank, observe the solvent manufacturer's recommendations for safe use and disposal.

SPECIFICATIONS

	M-1115S METHANOL
Housing Material	Lightweight, corrosion-resistant, nickel plated, cast aluminum body, convenient union ring for easy installation.
Pump Rate	Up to 12 GPM (45 LPM)
Duty Cycle	Intermittent, 30 minute ON, 30 minute OFF
Suction Lift	Manual Nozzle: Up to 5.5 feet (1.7 m) Automatic Nozzle: Up to 4.8 feet (1.5 m)
Operating Temperature	-20 °F to 125 °F (-29 °C to 52 °C)
Operating Pressure	15 PSI (1.03 bar)
Input	115-volt AC
Current Draw	1.8 amps
Motor	1400 RPM, 1/8 hp
Motor Approval	cULus Listed, Class I Div 1
Thermal Motor Protection	Auxiliary Temperature Limiting Device
Tank Adapter	2 inch NPT
Inlet	1 inch NPT
Outlet	3/4 inch NPT
Hose Type	N/A
Hose Size	N/A
Nozzle	N/A
Weight	14 lbs. (6.3 kg)

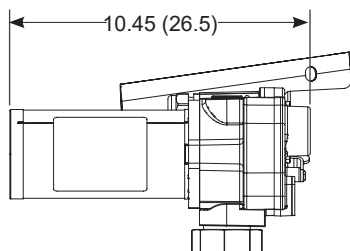
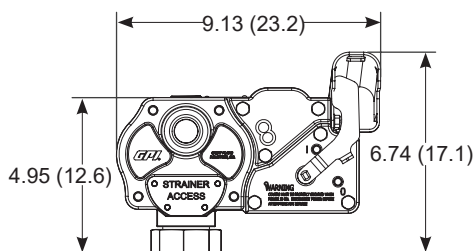


Figure 1
in (cm)

INSTALLATION INSTRUCTIONS

⚠ WARNING

Coverplates protect the operator from moving parts. Never operate the pump without coverplates in place. Never apply electric power to the pump without coverplates in place. Always disconnect power before repairing or servicing

⚠ DANGER

If the pump is to be installed in a hazardous (classified) location, it must be installed by a licensed electrician and conform to all National, State, and Local codes. Including, but not limited to; NEC/CSA 22.1/ANSI/IEC/NFPA 70, 30, and 30A. You, as the owner, are responsible for seeing that the installation and operation of your pump complies with all applicable codes. Rigid conduits must be used to install wiring. Note that the lead wires are factory-sealed, isolating the motor from the junction box. Failure to follow these wiring instructions may result in death or serious injury from shock, fire or explosion.

Mechanical Connections

NOTE: All threaded fuel connections must be sealed with thread tape or a pipe thread-sealing compound approved for use with petroleum fuels and tightened securely to prevent leakage.

NOTE: This pump must be mounted on a vented tank. If the tank is not vented, contact GPI for the correct vent.

NOTE: This pump is designed to mount directly to a standard 2 inch female tank using the adapter fitting (included) (see Figure 2). The suction pipe should extend to within 3 inches (7.62 cm) of tank bottom. Apply thread tape to the suction pipe thread and securely tighten the suction pipe to the pump inlet port.

NOTE: This pump is designed to self-prime with dry gears. Expect suction lift as follows:

Manual Nozzle: 6.7 feet (2.1 m) with methanol

Automatic Nozzle: 5.8 feet (1.8 m) with methanol

If you require a greater initial prime height, coat the gears with fluid by removing the plug on the top of the pump and pour a small quantity of motor oil into the gear cavity. Replace the plug and try again. A foot valve with pressure relief may be needed to maintain prime.

Install Tank Adapter and Suction Pipe

NOTE: Suction pipe is not included.

Wrap the tank side of the adapter with three or four turns of thread tape (see Figure 2). Using a pipe wrench, tighten the adapter securely into the fuel tank.

NOTE: For Aluminum Tank Installation - To prevent thread galling of aluminum fittings, always prepare the threads for assembly using an anti-seize compound such as Loctite® 567™, Hernon® Dripstop® 940, or equivalent.

1. Using pliers, remove the plastic plug from inlet port on bottom of pump. Place the spin collar gasket into the inlet fitting on the bottom of the pump (see Figure 3).
2. Clean the tank interior of all dirt and foreign material.
3. For the suction pipe, a 1 in. steel pipe cut to length and threaded on one end may be used. Suction pipe should extend to within 3 inches of tank bottom.
4. Wrap the threaded end of suction pipe with three or four turns of thread tape. Thread the suction pipe into the bottom of the adapter and hand tighten until snug.

INSTALLATION INSTRUCTIONS (CONTINUED)




Figure 2



Figure 3



Figure 4



Figure 5

Install Pump on Tank

1. Clean the tank interior of all dirt and foreign material.
2. Carefully lift pump / suction pipe assembly and insert suction pipe into the tank opening.

While holding the spin collar gasket in place, position the pump spin collar onto the tank adapter and tighten using a pipe wrench, making sure the spin collar is not cross-threaded (see Figure 7); The spin collar measures 2.26 inches (57.40 mm) across flats.

NOTE: To prevent pressure buildup and possible fuel leaks, make sure the fuel tank is properly vented. A vent cap rated at 3 psi (20.68 kPa) or less is recommended.



Figure 7

INSTALLATION INSTRUCTIONS (CONTINUED)

Install Hose and Nozzle

NOTE: Hose and nozzle not supplied. Owner must supply accessories suitable for methanol.

1. Using pliers, remove the plastic plug from outlet port on front of pump. Wrap one end of the dispensing hose with three to four turns of thread tape and thread into outlet port (see Figure 8). Tighten securely using an adjustable wrench.
2. Wrap opposite end of hose with three or four turns of thread tape and thread into nozzle. Tighten securely using an adjustable wrench (see Figure 9).
3. Place the nozzle into the nozzle holder on the end of the pump motor housing. Note that the nozzle cannot be placed in the holder unless the pump switch is OFF (see Figure 10).



Figure 8



Figure 9



Figure 10

INSTALLATION INSTRUCTIONS (CONTINUED)

Connect to a Power Source

IMPORTANT: The pump is designed for use with a 115-volt AC power source. Do not attempt installation on a 12-volt, 24-volt or 230-volt system.

⚠ DANGER Observe precautions against electrical shock when servicing the pump. Always disconnect power before repairing or servicing. Never apply electrical power to the system when any of the coverplates are removed.

⚠ WARNING It is important to exercise more than ordinary care with electrical installation and maintenance. Failure to follow these electrical connection instructions could result in death or serious injury from shock, fire or explosion.

IMPORTANT: Electrical wiring and connections must be made only by a licensed electrician in accordance with national, state and local electrical codes regarding Class 1, Division 1 requirements as well as NFPA Code 70 and 30. Other codes may apply.

1. Install UL Listed, rigid metal conduit and code-specified gasoline and oil-resistant wire with ground wire from switch box to the pump electrical box, using proper seal offs.
2. Remove the electrical coverplate (see Figure 11). Be careful not to damage gasket.
3. Route the wiring and conduit to the pump.
4. Attach wiring to pump wires using provided wire nuts.
5. Position all wires inside the pump electrical cavity and replace the coverplate.

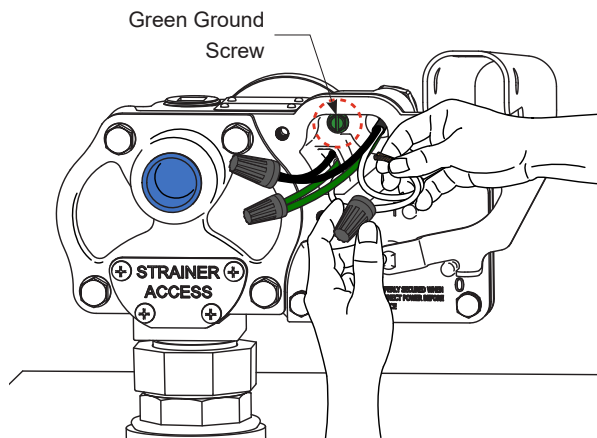


Figure 11

OPERATION

IMPORTANT: Always follow safety precautions when operating this equipment. Review the safety instructions.

⚠ DANGER *To prevent physical injury or property damage, observe precautions against fire or explosion when dispensing fuel. Do not operate the system in the presence of any source of ignition including running or hot engines, lighted tobacco products, gas or electric heaters, or any type of electronic device. A spark can ignite fuel vapors.*

⚠ CAUTION *Before each use, repair leaks around seals or connections. Make sure hoses are in good condition and connections are tight. If damaged, replace hoses before use.*

NOTE: Make sure the work area is dry.

⚠ WARNING *Make sure the pump is properly grounded. Repair any corroded or damaged wiring before use.*

NOTE: Ensure the tank contains enough fuel.

IMPORTANT: Make sure the fuel is not contaminated with debris. Tighten loose tank lids regularly.

Dispensing Fuel

Turn on the pump by removing the nozzle from the holder and pushing up the switch lever. Insert the nozzle into the receiving tank and squeeze the handle to start fuel flow. When done, release the nozzle handle, turn the pump off and return the nozzle to its holder.

IMPORTANT: This pump is designed to be self-priming. If fuel is not delivered within 15 to 20 seconds, turn the pump off and refer to priming information in the Troubleshooting Section.

⚠ CAUTION *An automatic bypass valve prevents pressure build up when the pump is on with the nozzle closed. To avoid pump damage, do not run the pump more than 10 minutes with the nozzle closed. Leaving the pump on with the nozzle closed for more than 10 minutes can damage the pump components and will void the warranty.*

⚠ CAUTION *Never leave the pump running without fluid. Dry running can damage the pump components, and will void the warranty.*

IMPORTANT: This is an intermittent duty pump, after running the pump for a maximum of 30 minutes, allow it to cool for 30 minutes.

IMPORTANT: The motor is provided with an internal temperature-limiting device. Excessive motor heat will trip the device and will only reset after the motor has cooled. If the device trips, turn the switch OFF and let the pump cool for 30 min. Turn the switch ON again when ready to operate. If the device trips again before the end of the duty cycle, see the troubleshooting guide.

⚠ CAUTION *Always turn the pump off if the temperature-limiting device trips. If left on, the pump will automatically reset when cool and start pumping.*

MAINTENANCE

NOTE: This pump is designed for minimum maintenance. The motor bearings are self-lubricating. Inspect the pump and components regularly for fuel leaks and make sure the hose and power cord are in good condition. If damaged, replace before use. Keep the pump exterior clean to help identify leaks.

IMPORTANT: Do not use this pump for water, chemicals or herbicides. Dispensing any fluid other than those listed in the owner's manual may damage the pump (see **BEFORE YOU BEGIN: Fueling Compatibility Statement** at front of the owner's manual). Use of the pump with unauthorized fluids will void the warranty.

Clean or Replace Strainer

1. Turn the pump off and disconnect from power. Remove the strainer coverplate, making sure not to damage the O-ring (see Figure 14). Remove the inlet strainer and inspect for damage or clogs (see Figure 12). Clean the strainer with a soft-bristled brush and solvent (see Figure 13). If the strainer is very dirty, compressed air may be used. If damaged, replace the strainer.
2. Place the strainer in the cavity. Clean the coverplate and O-ring. Coat the O-ring lightly with grease. Ensure the coverplate O-ring is properly seated (see Figure 14) and tighten the strainer coverplate.



Figure 12




Figure 13



Figure 14

MAINTENANCE, TROUBLESHOOTING, AND REPAIR (CONTINUED)

Scan the QR code below for more maintenance,
troubleshooting, and repair resources.

EN

Escanee el código QR a continuación para obtener más
recursos de mantenimiento, solución de problemas y
reparación.

ES

Scannez le code QR ci-dessous pour accéder à des
ressources supplémentaires sur la maintenance, le
dépannage et la réparation.

FR



NOTES/ NOTAS/ REMARQUES

This image shows a single sheet of white paper with horizontal ruling lines. The lines are evenly spaced and run across the width of the page. There are no margins, text, or other markings on the paper.



Limited Warranty Policy

Great Plains Industries, Inc. hereby provides a limited warranty against defects in material and workmanship on all products Great Plains Industries, Inc. manufacturers. The warranty period shall begin on the date of purchase confirmed with the original purchase receipt or, if not available, the date of manufacture. Manufacturer's sole obligation under the following warranties will be limited to either, at Manufacturer's option, replacing or repairing defective goods. If the product is no longer available, replacement may be made with a similar product of equal or greater value. Buyer's exclusive remedy for breach of any such warranties will be enforcement of such obligations of Manufacturer. The warranty shall extend to the purchaser of this product and to any person to whom such product is transferred during the warranty period.

Warranty shall not apply if:

The product has been subjected to neglect, misuse, abuse or damage or has been installed or operated other than in accordance with the manufacturer's operating instructions or the product has been altered or modified outside the warrantor's duly appointed representative.

Product components considered wear items, i.e. vanes, etc., are NOT included within the scope of this warranty.

Charges for shipping and insuring packages to Great Plains Industries, Inc. are the customer's responsibility. Great Plains Industries, Inc. will ship the warranted product back to the customer via ground shipping free of charge for shipments within the United States. International shipping charges and customs fees to and from Great Plains Industries, Inc. are the customer's responsibility.

GREAT PLAINS INDUSTRIES, INC., EXCLUDES LIABILITY UNDER THIS WARRANTY FOR DIRECT, INDIRECT, INCIDENTAL AND CONSEQUENTIAL DAMAGES INCURRED IN THE USE OR LOSS OF USE OF THE PRODUCT WARRANTED HEREUNDER.

THE COMPANY HEREWITH EXPRESSLY DISCLAIMS ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE OTHER THAN FOR WHICH IT WAS DESIGNED.

THIS WARRANTY GIVES YOU SPECIFIC RIGHTS AND YOU MAY ALSO HAVE OTHER RIGHTS WHICH VARY FROM U.S. STATE TO U.S. STATE.

In compliance with MAGNUSON MOSS CONSUMER WARRANTY ACT - PART 702 (governs the resale availability of the warranty terms)

**To obtain warranty service,
contact Product Support:**

800-835-0113

Technical experts will guide you through a troubleshooting process to determine appropriate corrective actions.

The following respective warranty periods apply:



FIVE-YEAR WARRANTY applies to the following product families:

GPRO® Fluid Transfer Pumps:
V25-012, V25-024, V20-115,
V20-230, PRO35-115

GPRO® Remote Dispensers:
QM40-RD

GPRO® Fuel Meters: QM40

GPI® Fuel Meters: M30



TWO-YEAR WARRANTY applies to the following product families:

GPI® Fluid Transfer Pumps:
G8P, EZ8, M-150S, M-180S,
M-240S, G20-012*, M-1115S,
P-200, PA-200, P-200H, PA-200H,
HP-100, DP-20, RP-10

GPI® Fluid Meters:
01A, 01N, FM-300H,
LM51DN, LM-300



ONE-YEAR WARRANTY applies to the following products:

GPI® Oil Transfer Pumps:
L5020, L5116, L5132



90-DAY WARRANTY applies to the following products:

GPI® Fluid Transfer Hand Pumps:
RP-5, BP-12, LP-50

90-DAY WARRANTY applies to Spare Parts, Kits and Accessories including Nozzles*, Hoses, Swivels, Vent Caps, Filter Adapters, etc.

90-DAY WARRANTY applies to Factory Repairs from repair date or the balance of the original warranty whichever is longer.

**Extended warranty coverage available on select products.*

Requires registration of product with manufacturer.

Visit greatplainsindustries.com/register-your-product



COMPANY HEADQUARTERS:
5252 East 36th Street North
Wichita, KS, USA 67220-3205

GreatPlainsIndustries.com