

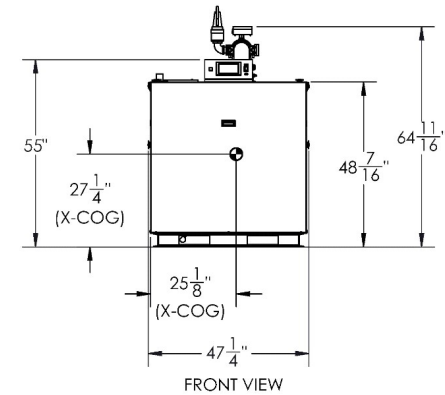
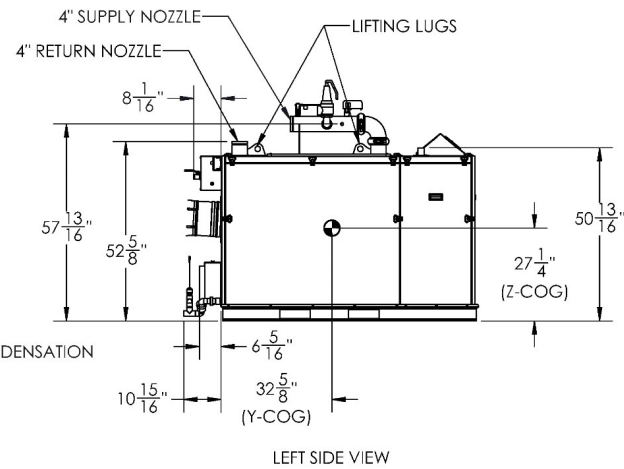
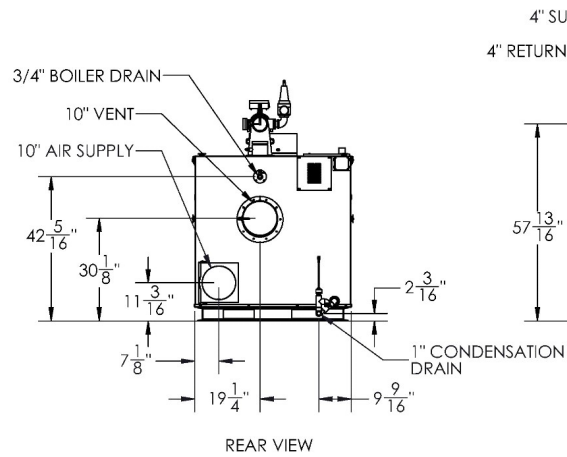



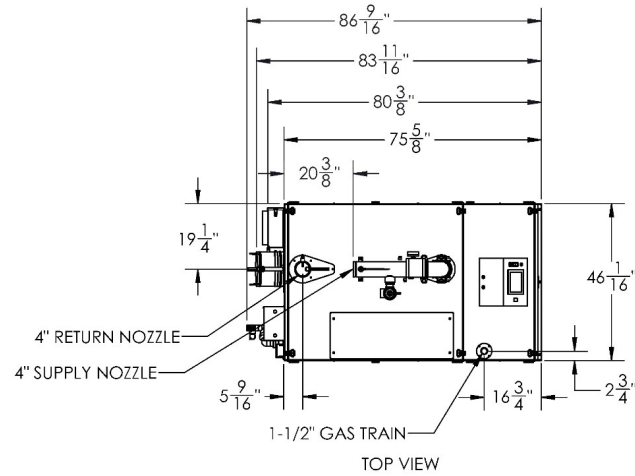

# Boiler SUBMITTAL DATA SHEET



PO BOX 3244 | LANCASTER, PA 17601

AMP-3000

INNOVATIVE EQUIPMENT FOR  
HOT WATER SYSTEMS

WWW.THERMALSOLUTIONS.COM

Updated 2/24/26

ABC260201



# Boiler SUBMITTAL DATA SHEET

| RATINGS AND CAPACITIES                          |                        |                        |
|---|------------------------|------------------------|
| Input - Low fire:                               | 600,000                | BTU/HR                 |
| Input - High Fire:                              | 3,000,000              | BTU/HR                 |
| Output - High Fire:                             | 2,910,000              | BTU/HR                 |
| Boiler Horsepower:                              | 87                     | BHP                    |
| Recovery Rate(based on 100°F temperature rise): | 97                     | Gallons Per Hour (GPH) |
| Thermal / Combustion Efficiency %:              | 97                     |                        |
| Heating Surface:                                | 300                    | Sq.Ft.                 |
| Water Vol. (gal):                               | 36                     | Gallons                |
| Fuel:   | Natural Gas or LP      |                        |
| Firing Rate:                                    | Full Modulation        |                        |
| Burner Turndown:                                | 5:1                    |                        |
| Low NOx Emissions:                              | <10 ppm                |                        |
| Inlet Gas Pressure (NG):                        | 4" (Min.) / 14" (Max.) |                        |
| Inlet Gas Pressure (LP):                        | 8" (Min.) / 14" (Max.) |                        |
| Approx. Shipping Weight (lb):                   | 2,038                  | lbs.                   |

| FLOWS AND PRESSURE DROPS |            |                |
|--------------------------|------------|----------------|
| Delta T                  | Flow (GPM) | Head Loss (ft) |
| 20°                      | 291        | 20.0           |
| 30°                      | 194        | 11.3           |
| 40°                      | 145        | 7.7            |

| Electrical Requirements: (Appliance Only) |         |       |    |               |
|---|---------|-------|----|---------------|
| Model                                     | Voltage | Phase | Hz | Max. Amp Draw |
| 2000-2500                                 | 120     | 1     | 60 | 13.5          |
|   | 208     |       |    | 8.2           |
|   | 240     |       |    | 7.7           |
|   | 208     | 3     | 60 | 11            |
|   | 240     |       |    | 9.9           |
|   | 480     |       |    | 6.4           |
| 3000                                      | 208     | 1     | 60 | 14.1          |
|   | 240     |       |    | 12.6          |
|   | 208     | 3     | 60 | 9.9           |
|   | 480     |       |    | 6.4           |
| 3500-4000                                 | 208     | 3     | 60 | 11            |
|   | 240     |       |    | 9.9           |
|   | 480     |       |    | 6.4           |

ASME Section IV (Max 160 PSIG / 210°F)



Setpoint range is 60-185°F

Adjustable, manual reset high limit setting of ≤ 200°F.

ASME H stamp MAWT is 210°F for the vessel. (For max setpoint, see Setpoint range.)

ETL Certified to ANSI Z21.13 / CSA 4.9

ETL Certified to UL 795 / CSA 3.1

| DIMENSIONS / CONNECTIONS    |        |          |
|-----------------------------|--------|----------|
| Height:                     | 55     | (Note 1) |
| Width:                      | 46     | (Note 2) |
| Length:                     | 75-5/8 | (Note 3) |
| Water Outlet Pipe (FNPT):   | 4      |          |
| Water Inlet Pipe (MNPT):    | 4      |          |
| Vent Connection:            | 10     |          |
| Air Intake Connection:      | 10     |          |
| Condensate Drain (PVC):     | 1      |          |
| Drain Line Connection:      | 3/4    |          |
| Gas Inlet Connection (FPT): | 1 1/2  |          |

| NOTES:  |
|---|
| 1. Height dimension is from floor to top of jacket. |
| 2. Length is from jacket front to jacket rear.      |
| 3. Dimensions shown are for reference only          |
| 4. Refer to manual for gas supply piping charts     |



# Boiler SUBMITTAL DATA SHEET

## STANDARD EQUIPMENT

### PRESSURE VESSEL DESIGN

Stainless Steel Heat Exchanger  
 ASME Section IV Certified, "H" Stamp  
 MAWP 160 PSIG & Max Temp 210°F  
 Setpoint range is 60-185°F  
 Adjustable, manual reset high limit setting of ≤ 200°F.  
 ASME H stamp MAWT is 210°F for the vessel. (For max setpoint, see Setpoint range.)  
 Ten Year Limited Pressure Vessel Warranty

### COMBUSTION DESIGN

|  |                                  |
|--|----------------------------------|
| Stainless Steel Pre-Mix Burner                     | Zero governor gas valve          |
| Low NOx Emissions ( < 10 ppm)                      | Variable Speed Combustion Blower |
| Full Modulation, 5:1 Turndown                      | Air Proving Switch               |
| Blocked Vent Switch                                | Blocked Vent Switch              |
| Natural Gas, Propane or Dual Fuel (Gas/Gas)        |                                  |
| 4" wc (8" wc Propane) to 14" wc inlet gas pressure |                                  |
| Manual fuel changeover switch (Dual Fuel Only)     |                                  |
| 4" wc (8" wc Propane) to 14" wc inlet gas pressure |                                  |
| High/Low gas pressure switches, manual reset       |                                  |
| Direct Spark Ignition System with UV Scanner       |                                  |

### VENTING

Category II or IV Venting  
 Individual or Common (Engineered) Vent System  
 Vertical or Horizontal  
 CPVC, PP or SS Venting \*Materials Acceptable  
 Combustion Air Intake - Sealed or Room

\* Flue system material shall be capable of continuous operation at 210°F or higher and shall be certified to UL 1738 – venting system for gas-burning appliances cat II, III and IV.

### BOILER EQUIPMENT

|   |   |
|---|---|
| Concert™ Control (24 Vac)                 | Water Flow Switch                                 |
| High Limit Temp Control, Manual Reset     | Condensate trap                                   |
| Low water cutoff, manual reset            | Blocked Condensate Switch                         |
| Supply & Return Water Temperature Sensors | Pressure & Temperature Gauge                      |
|   | Flue Gas Temperature Sensor                       |
| ASME Relief Valve:                        | (Available: 30, 50, 60, 75, 100, 125 or 150 psig) |

### ELECTRICAL DESIGN

#### Models 2000-2500:

- 120-208-230VAC/60HZ/1PH - High Voltage  
 (2000 to 2500 - Optional 208-230-460VAC/60HZ/3PH)

#### Models 3000:

- 208-230-240VAC/60HZ/1PH - High Voltage  
 - 208-230-240-460VAC/60HZ/3PH - High Voltage

#### Models 3500-4000:

- 208-230-240-460VAC/60HZ/3PH - High Voltage  
 - PCB (Printed Circuit Board) Fused Connections  
 24VAC/5VDC - Low Voltage PCB  
 - EMS Communications  
 (Dual RJ45 Jacks for Peer-To-Peer or ModBus)  
 - Boiler Options (Sensors)  
 - Pumps (Boiler, DHW, System) & Auxiliary Devices



# Boiler SUBMITTAL DATA SHEET

## OPTIONAL EQUIPMENT

- Hydronic Kit (Boiler Circulation Pump, Pump Flange Kit and Condensate Neutralizer)
- External High Limit Temperature Control, Manual Reset
- Condensate Neutralizer
- Supply Header Temperature Sensor:  Direct Immersion  Well Immersion (with Well)
- Outdoor Air Temperature Sensor (Wired)
- EMS Signal Converter Kit (Converts Energy or Building Management System 0-10v signal to 4-20mA)
- Motorized Isolation Valves
- Alarm Buzzer with Silencing Switch
- Gas Valve Proving Switch
- Vent Adapter - CPVC
- Universal Communications Gateway (BACnet, Metasys, Modbus or Lonworks)
- Stackable Rack
- Conductor Sequencing Panel  Optional Isolation Relay Board

The Conductor manages multiple condensing & non-condensing, small & large heat output, new and/or existing boilers (full modulation or on-off), and steam or hot water applications. It helps improve system efficiency by selecting and modulating the right boiler to match operating conditions. The Conductor offers a single point boiler plant Energy Management System (EMS) interface including Modbus TCP/IP, Modbus RTU RS485, BACnet/IP and BACnet MSTP standard. If Lonworks needed, add for the separate Lonworks gateway.


## EXTENDED WARRANTY

- 3-Year Parts
- 5-Year Parts
- 10-Year Parts
- 5-Year Parts/Labor
- 10-Year Parts/Labor



# Boiler SUBMITTAL DATA SHEET

## CONCERT CONTROL FEATURES

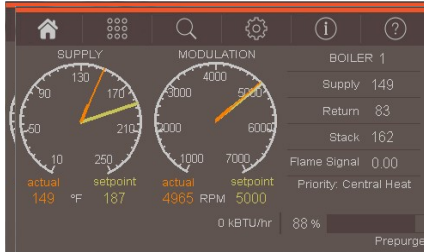

### **Dashboard - Color Touchscreen Display, 4"**

- Intuitive Icon Navigation
- "Quick" Setup Menus
- \*Real Time BTU/H Display

### **Two (2) Temperature Demand Inputs**

- Outdoor Air Reset Curve for Each Input
- Time of Day Setback Capability
- (Envirocom Thermostat must be installed)

### **Three (3) Pump Control**

- Boiler Pump With On/Off or Variable Speed Control
- Domestic Hot Water (DHW) Pump
- System Pump
- Alternative Control to Combustion
  - Air Damper or Standby Loss Damper
- Pump Overrun for Heat Dissipation
- Pump Exercise
- Pump Rotor Seizing Protection

### **Peer-to-Peer Boiler Communications**

- Multiple Size Boiler Sequencing Up to 8 Units
- \*Two (2) Boiler Start/Stop Trigger
- Lead Boiler Automatic Rotation

### **Energy Management System (EMS) Interface**

- \*Firing Rate and Water Temperature Based Algorithms for Multiple Boilers; loss of EMS signal defaults to local boiler settings
- 420mAdc Input/Output (010Vdc Optional Converter)
- ModBus Input/Output (BACnet or LonWorks Optional Gateway)
- Simultaneous Interface with Peer-to-Peer

### **USB Data Port Transfer**

- Upload Settings Between Boilers
- Download Parameters for Troubleshooting
- Import Data into .CRV Formatted Files for Performance Analysis

**\* Unique to Concert**



### **Energy Efficiency Enhancer**

- AntiCycling Technology
- Multiplier boiler base load common rate
- Outdoor Air Temperature Reset Curve
- Warm Weather Shutdown
- Boost Temperature & Time
- Ramp Delay
- OverTemperature Safeguarding

### **Self-Guiding Diagnostics**

- Identifies Fault
- Describes Possible Problems
- Provides Corrective Actions
- Time/Date Stamp on Alarms and Lockouts

### **Unmatched Archives**

- Historical Trends Collects Up to 4 months Data
- Event History Up to 3000 Alarms, Lockouts and Cycle & Run Times
- Alarm Limit String Faults, Holds, Lockouts and Others
- Cycle & Run Time Boilers & Pumps
- Resettable (Lockouts/Alarms/Cycles & Run Time)

### **Domestic Hot Water Priority**

- DHW Tank Piped With Priority in the Boiler Loop
- DHW Tank Piped as a Zone in the System With the Pumps Controlled by the Concert Control
- DHW Modulation Limiting
- Status Screens
- Sensor Monitoring and Control

### **Other Features**


- Factory Default Settings
  - Three Level Password Security
  - Frost Protection
- Contractor Contacts (Up to 3)
- Low Water Flow Safety Control & Identification
- Proportion Integral Derivative (PID) Parameters for Central Heat, DHW, Sequencer and Fan

### **Boiler Connect Compatible \***

\* Models 2000-4000 require Service Tool PCB14 Kit (PN# 113430-01) and one (1) Boiler Connect Bluetooth Adapter Kit (PN# 113329-01) per install or cascade.



# Boiler SUBMITTAL DATA SHEET

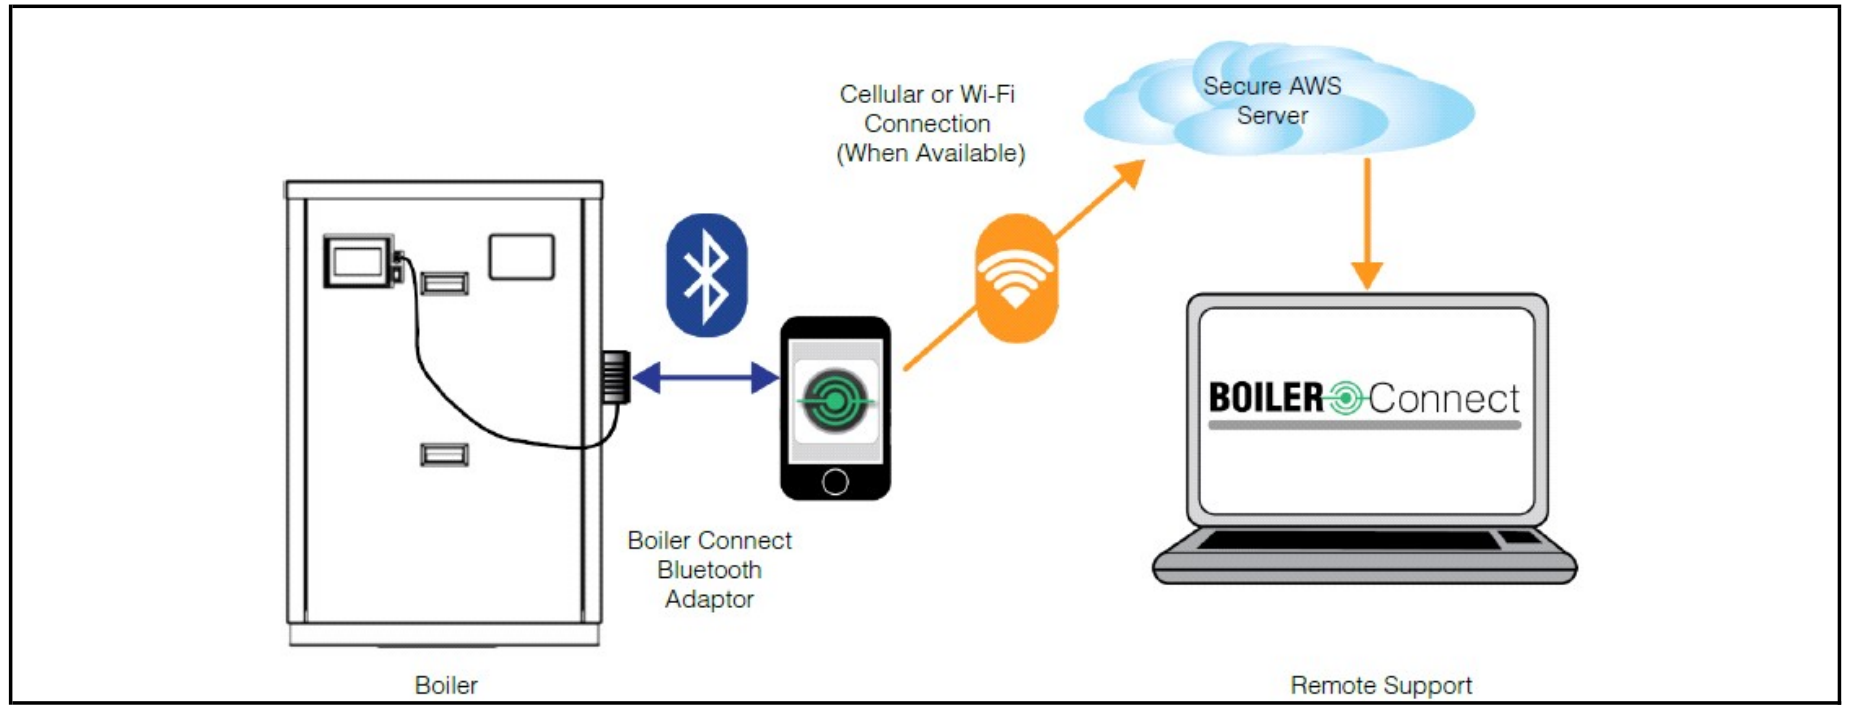

## BOILER Connect

### BOILER CONNECT FEATURES

- Bluetooth adaptor connects to the Boiler Connect App
- English or Spanish language
- Start-up, Troubleshooting Tips and Service Wizards
- Data logs, Service and Status Reports sent to the cloud
- Live Data Sharing (Cellular Service Required) with Technical Service Representative