


I/O | INSTALLATION INSTRUCTIONS

CABLES TO CEILING

Available for all models

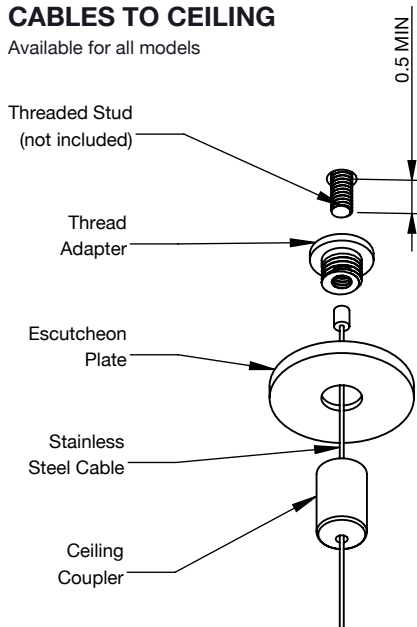

A | Attach canopy to junction box with (2) mounting screws (not included). Use curved slots in canopy.

B | Prior to the installation of fixture, install 1/4-20 threaded studs (not included) into ceiling. Leave at least 0.5" exposed

C | Attach stainless steel cables to threaded studs using couplers, as shown to the left.



D | Depress plunger on cable gripper to feed stainless steel cable through gripper, located on top of fixture.

E | Raise fixture to desired height. Level fixture, and trim off excess cable.

F | Determine cord length between canopy and fixture. Trim and strip electrical cord to the appropriate length.

G | Feed power cord through strain relief in canopy dress plate and make all electrical connections — SEE WIRING DIAGRAM BELOW.

H | Attach dress plate to canopy with the (2) mounting screws provided. Tighten set screw on the strain relief to secure cord.

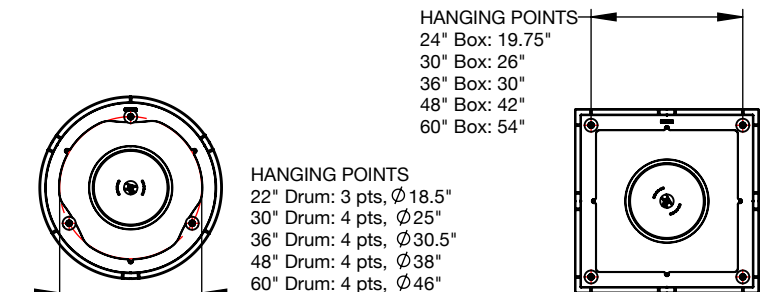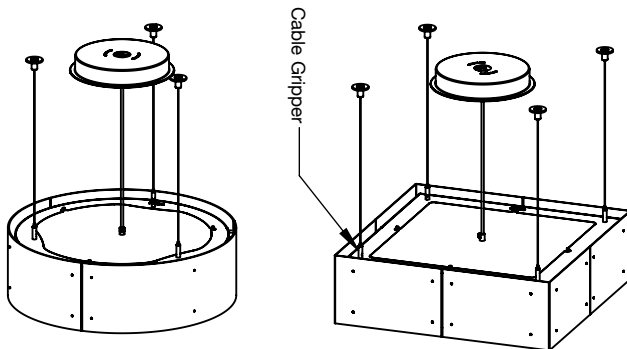

0-10V Dimming

WIRING DIAGRAM

For illustration purposes only. Consult control manufacturer's spec. sheets for specific wiring requirements and fixture capacity.

NOTICE:

- Wire according to appropriate manufacturers wiring diagrams
- WARNING: Risk of shock from energized equipment.
- Always turn power OFF and lock out during fixture installation
- This product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.
- SUITABLE FOR DAMP LOCATIONS
- CONTACT MANUFACTURER FOR LED REPLACEMENT

WARNING:

LIGHTART IS NOT LIABLE FOR DAMAGE DUE TO MISWIRING 0-10 VOLT CONTROL WIRES, OR LOW VOLTAGE LED WIRES TO LINE VOLTAGE.

