



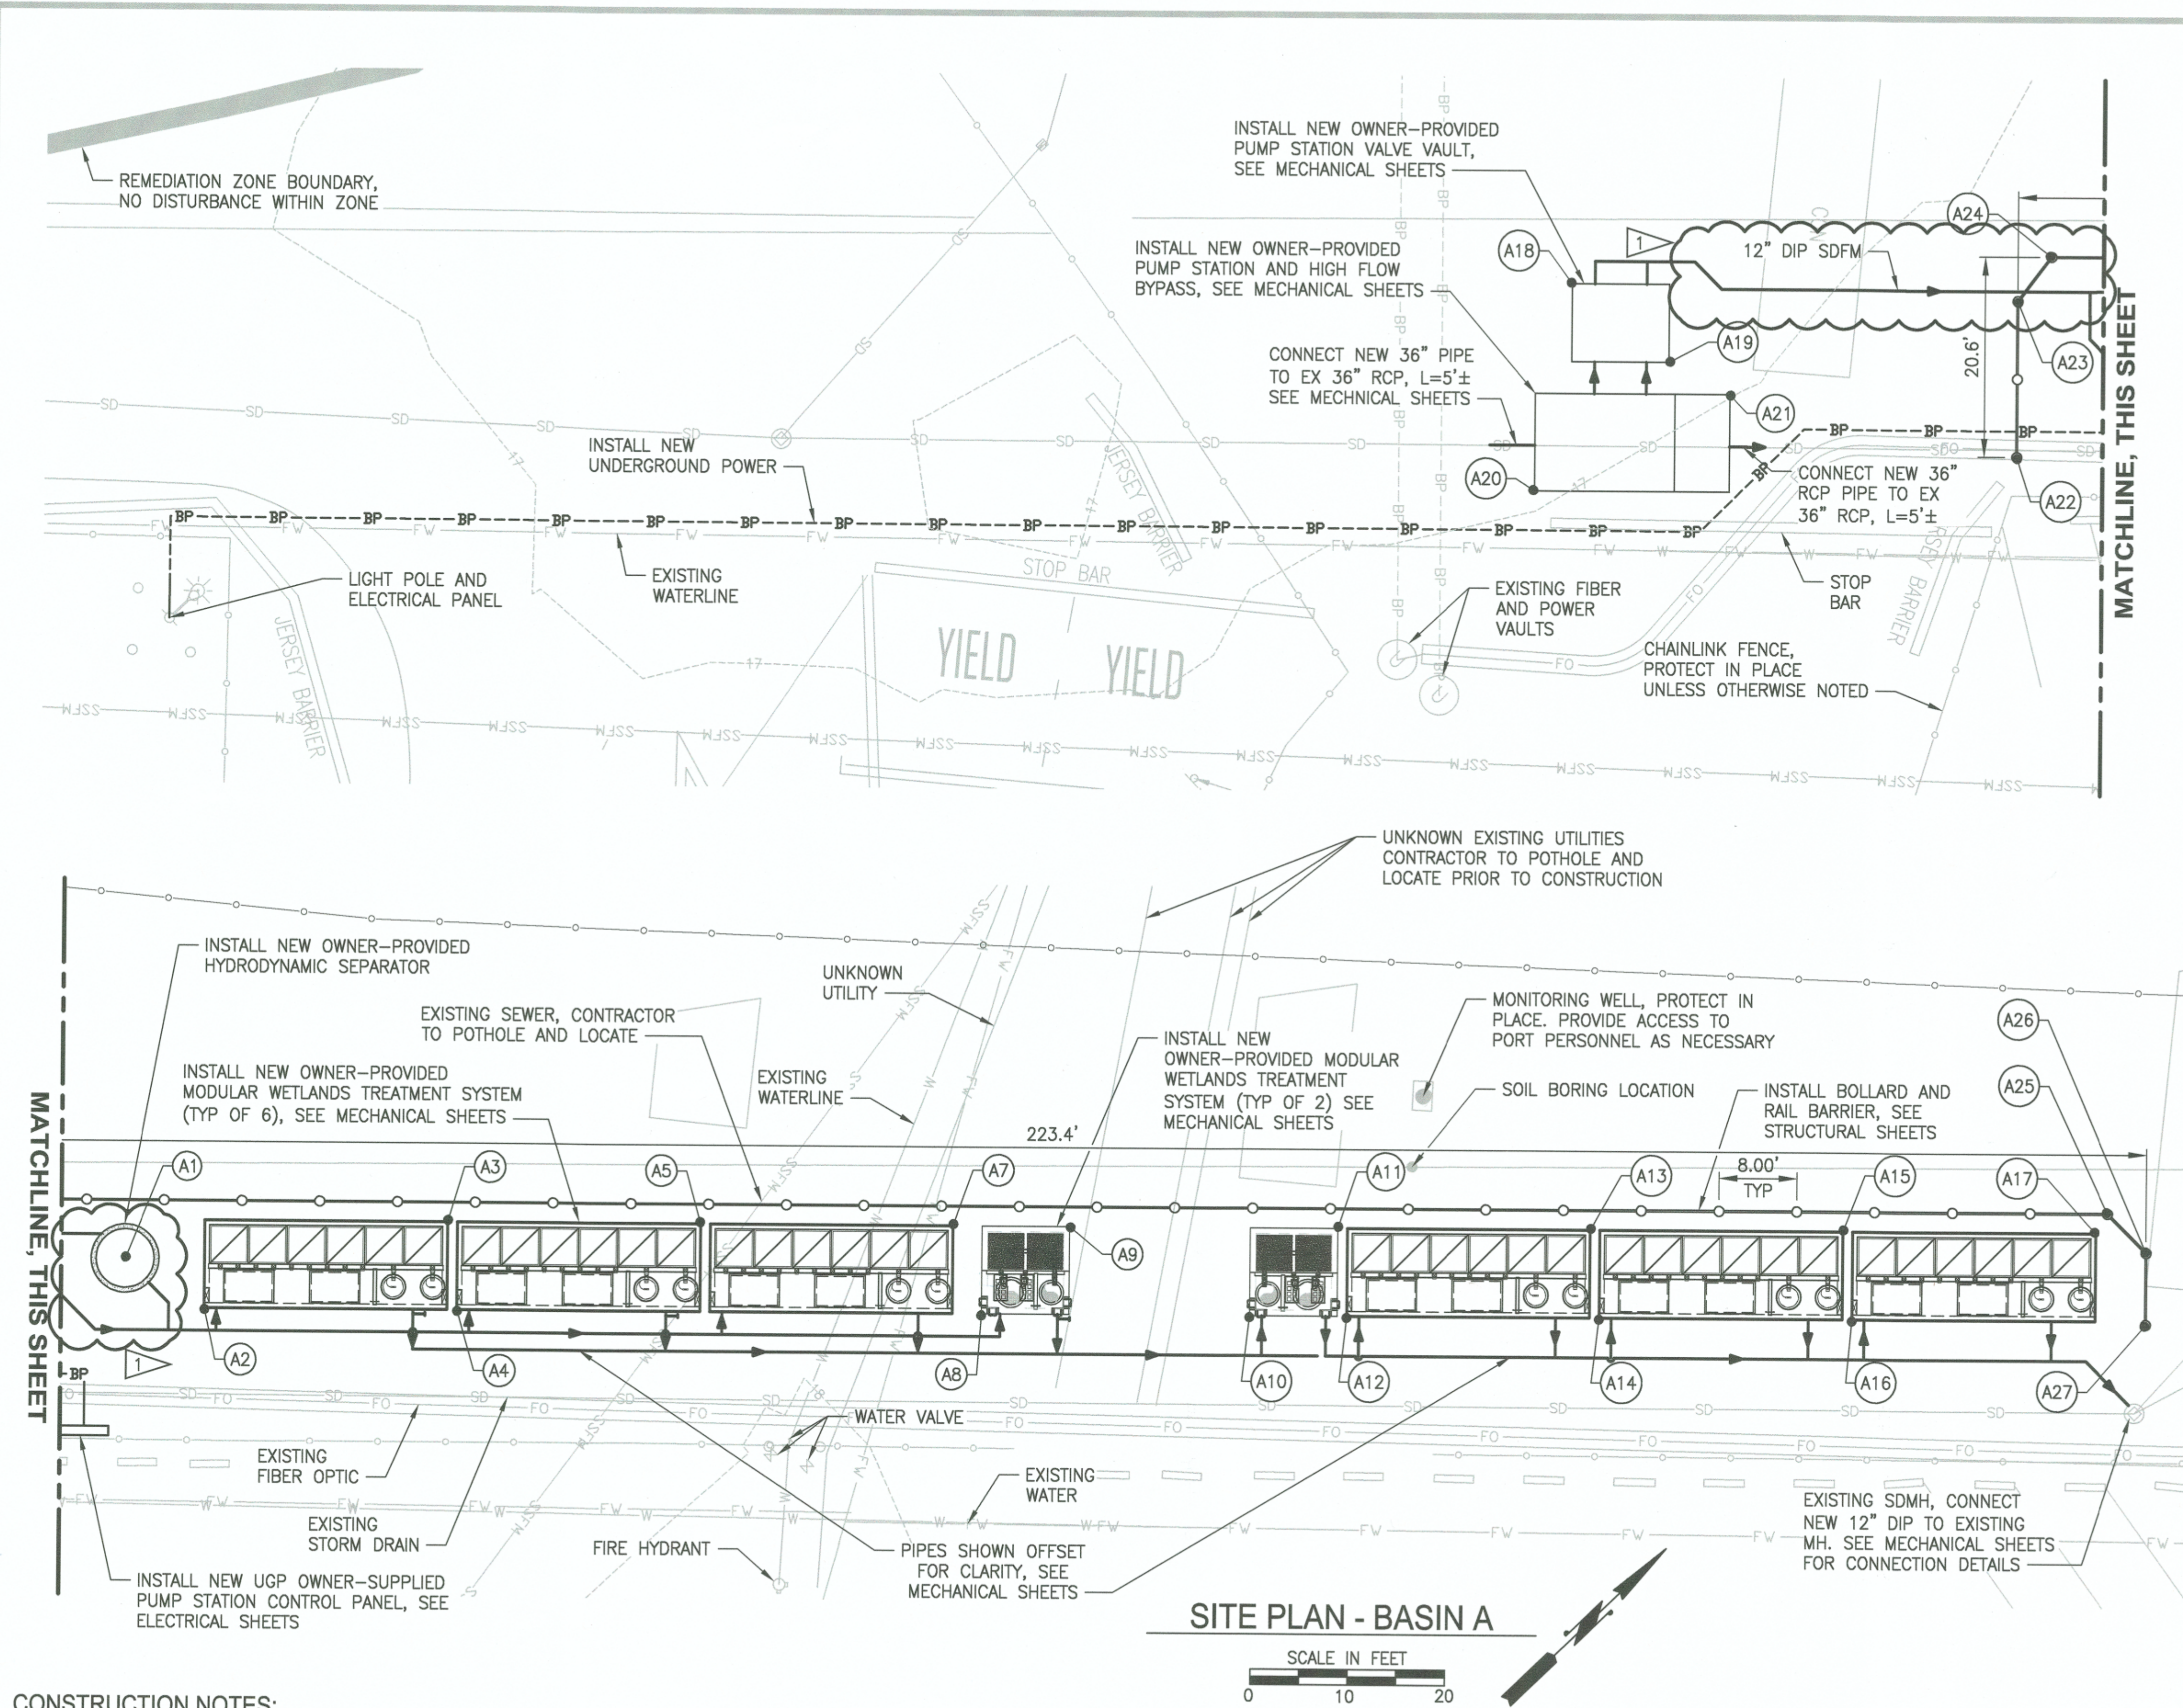

CONSTRUCTION NOTES:

- CONTRACTOR SHALL COORDINATE WITH OWNER AND EQUIPMENT SUPPLIERS FOR DELIVERY, INSTALLATION, AND COMMISSIONING OF OWNER-SUPPLIED EQUIPMENT, INCLUDING THE PUMPING STATIONS, HYDRODYNAMIC SEPARATORS, AND INDUSTRIAL MEDIA MODULAR WETLAND TREATMENT SYSTEMS.
- SEE MECHANICAL AND ELECTRICAL SHEETS FOR WORK SCOPE DELINEATION DETAILS.
- PRIOR TO COMMISSIONING OF TREATMENT SYSTEMS, CONTRACTOR SHALL CLEAN EXISTING STORM DRAIN STRUCTURES UPSTREAM OF TREATMENT SYSTEMS TO END OF PIPE BY FLUSHING ONE PIPE VOLUME MINIMUM, AND IN ACCORDANCE WITH WSDOT 7-07.
- SEE SHEET G07 FOR WORK AND STAGING AREA LIMITS.
- ALL FILL MATERIAL SHALL BE COMPACTED TO 95% RELATIVE DENSITY.
- CONTRACTOR SHALL MATCH EXISTING GRADES UNLESS SHOWN OTHERWISE.
- COORDINATES (CO) ARE APPROXIMATE. CONTRACTOR SHALL VERIFY LOCATIONS BASED ON EXISTING CONDITIONS AND EQUIPMENT INSTALLATION REQ'TS.
- CONTRACTOR SHALL VERIFY PIPE DIAMETERS AND MATERIAL PRIOR TO CONNECTION.
- RESTORE PAVEMENT STRIPING AS REQUIRED.
- RELOCATE EXISTING UTILITIES AS NECESSARY BASED ON RESULTS OF FIELD EXPLORATIONS. CONFIRM RELOCATION WITH PORT AND ENGINEER PRIOR TO PERFORMING WORK.
- ALL JOINT, FITTINGS, AND VALVES SHALL BE RESTRAINED.
- PREPARE SUBGRADE PER GEOTECHNICAL REPORT. SEE MECHANICAL SECTIONS FOR DETAILS.
- CONTRACTOR TO POTHOLE PRIOR TO CONSTRUCTION AND CONFIRM MATERIAL, SIZE, HORIZONTAL AND VERTICAL LOCATIONS OF EXISTING UTILITIES.

POINT TABLE			
POINT #	NORTHING	EASTING	DESC
A			
A1	709427.02	1164984.85	HYDRODYNAMIC SEPARATOR - CENTER
A2	709429.45	1164994.13	MWS 8x24 - SOUTH CORNER
A3	709453.70	1165004.99	MWS 8x24 - NORTH CORNER
A4	709448.18	1165012.17	MWS 8x24 - SOUTH CORNER
A5	709472.43	1165023.03	MWS 8x24 - NORTH CORNER
A7	709491.16	1165041.06	MWS 8x24 - NORTH CORNER
A8	709487.08	1165049.63	MWS 8x8 - SOUTH CORNER
A9	709499.80	1165049.39	MWS 8x8 - NORTH CORNER
A10	709506.94	1165068.76	MWS 8x8 - SOUTH CORNER
A11	709519.67	1165068.52	MWS 8x8 - NORTH CORNER
A12	709514.14	1165075.69	MWS 8x24 - SOUTH CORNER
A13	709538.39	1165086.55	MWS 8x24 - NORTH CORNER
A14	709532.87	1165093.73	MWS 8x24 - SOUTH CORNER
A15	709557.12	1165104.59	MWS 8x24 - NORTH CORNER
A16	709551.60	1165111.76	MWS 8x24 - SOUTH CORNER
A17	709575.85	1165122.62	MWS 8x24 - NORTH CORNER
A18	709384.91	1164940.22	VALVE VAULT - WEST CORNER
A19	709386.57	1164952.92	VALVE VAULT - EAST CORNER
A20	709367.48	1164952.96	PUMP STATION - SOUTH CORNER
A21	709388.84	1164959.63	PUMP STATION - NORTH CORNER
A22	709405.78	1164984.62	BOLLARD
A23	709416.88	1164973.10	BOLLARD
A24	709422.53	1164972.21	BOLLARD
A25	709578.12	1165122.03	BOLLARD
A26	709578.23	1165127.68	BOLLARD
A27	709573.11	1165133.00	BOLLARD

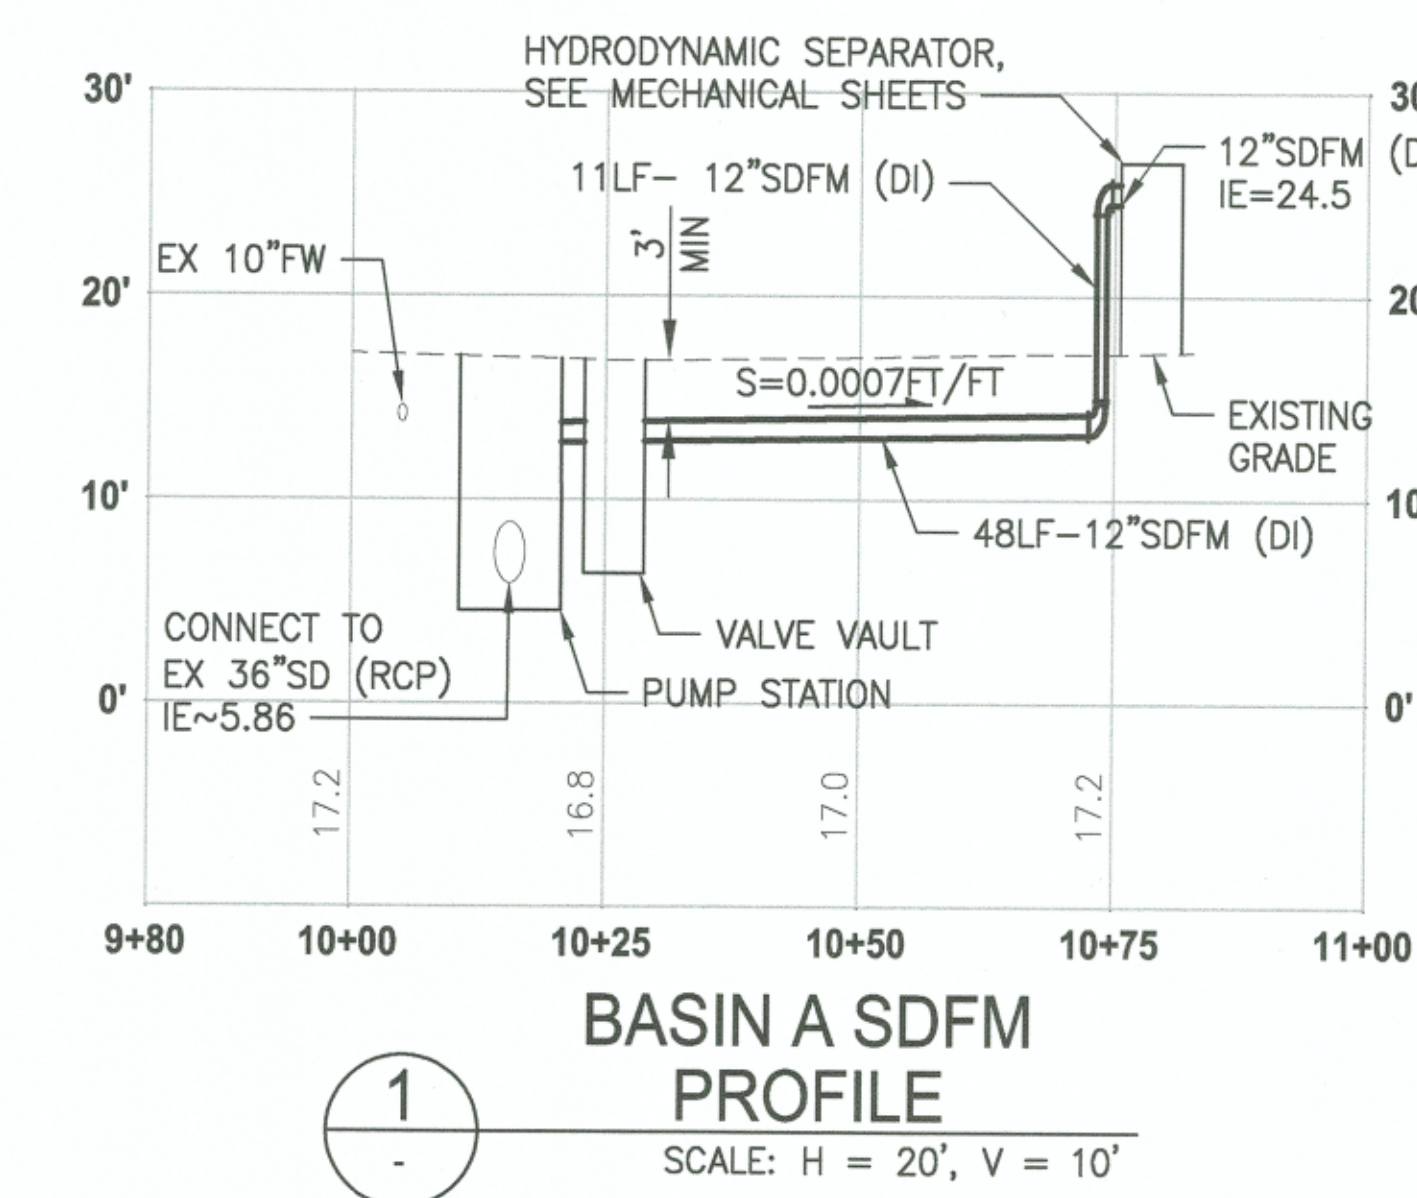

ENGINEERING PLANNING ENVIRONMENTAL SCIENCES
40 WASHINGTON AVENUE, SUITE 390
BREMERTON, WA 98337
P 360.377.0014
WWW.PARAMETRIX.COM

DATE: 5/16/18
BY: CIS
REVISION: 4
APPENDIX 1

APPROVED: *Dana Lindorby*
DIRECTOR ENG. DATE: 5/16/18
PRINTED BY: underbrn May 16, 2018
PORT ADDRESS: ONE SITCUM PLAZA
TACOMA, WA 98401-1837

WEST SITCUM STORMWATER TREATMENT
SITE PLAN - BASIN A

6583
C01
SH 11 OF 47
CONT/CONS: 070664
M. ID: 201024.01
PHASE: BID SET

TOWNSHIP: 21N
RANGE: 3E
SECTION: 33 & 34
DAT-HRZ: WAB3-S
PARCEL: SEE G02
DRAWING SCALE: AS NOTED